

INFORMATYKA AUTOMATYKA POMIARY

W GOSPODARCE i OCHRONIE ŚRODOWISKA

ISSN 2083-0157

Kwartalnik Naukowo-Techniczny



www.e-IAPGOS.pl



fot. Michał Stopel

**XXXII Zjazd Dziekanów Wydziałów Elektrycznych,
Elektroniki, Telekomunikacji, Automatyki i Robotyki,
Cybernetyki, Mechatroniki oraz Informatyki
19-21 maja 2022 r., Politechnika Bydgoska**

XXXII Congress of Deans of the Faculties of Electrical, Electronics, Telecommunications, Automatics, Robotics, Cybernetics, Mechatronics and Computer Science

The XXXII Congress of Deans of the Faculties of Electrical, Electronics, Telecommunications, Automatics, Robotics, Cybernetics, Mechatronics and Computer Science took place in Bydgoszcz between 19-21 May 2022. The congress is a cyclical undertaking, the individual editions of which were organized in various universities in Poland. The first congress was held in Silesian University of Technology in Gliwice in 1991. The Deans met for the second time in Bydgoszcz in 2003.

Dean's Reunions is a long and glorious tradition continued in many academic environments. This year, the organizer of the Congress was the Faculty of Telecommunications, Computer Science and Electrical Engineering of the Bydgoszcz University of Science and Technology named after Jan and Jędrzej Śniadecki. It is the youngest in the noble group of polytechnic schools in our country, although with 70 years of tradition. It was established 7 months ago as a result of changing the name of the UTP University of Sciences and Technology named after Jan and Jędrzej Śniadecki in Bydgoszcz. It was an undoubted honor for this young University to host such honorable guests representing renowned universities from all over the country. For years, the conventions have been a place for exchanging experiences and sharing the so-called good practices between the Authorities of individual departments. The Congress allows new members of our community to establish invaluable direct contacts. During the speeches invited guests raised the most bothersome issues in the field of science, education, organization and cooperation with the economic environment. The event was supported by L.K. Control from Bydgoszcz. Nearly 90 participants took part in the congress. During the 3 days of the congress there were 8 invited speeches. The participants had the opportunity to take part in a trip around Bydgoszcz, during which they visited the most important attractions of the city.

The next Congress of Deans will take place in the Military University of Technology in Warsaw.



foto: arch. PBS

2/2022

kwiecień – czerwiec

Wydanie pod redakcją naukową
prof. dr hab. inż. Waldemara Wójcika

INFORMATYKA AUTOMATYKA POMIARY

W GOSPODARCE I OCHRONIE ŚRODOWISKA

Informatics Control Measurement in Economy and Environment Protection

p-ISSN 2083-0157, e-ISSN 2391-6761, www.e-iapgos.pl

EDITOR STAFF ZESPÓŁ REDAKCYJNY

Editor-in-Chief
Redaktor naczelny

Pawel KOMADA
Lublin University of Technology, Lublin, Poland
p.komada@pollub.pl

Deputy Editors
Zastępcy redaktora

Jan SIKORA
Research and Development Center Netrix S.A.,
Lublin, Poland sik59@wp.pl

Dominik SANKOWSKI
Lodz University of Technology, Lodz, Poland
dsan@kis.p.lodz.pl

Pavel FIALA
Brno University of Technology, Brno, Czech
Republic fialap@feec.vutbr.cz

Andrzej SMOLARZ
Lublin University of Technology, Lublin, Poland
a.smolarz@pollub.pl

Technical Editor
Redaktor techniczny

Tomasz ŁAWICKI
Lublin University of Technology, Lublin, Poland
t.lawicki@pollub.pl

Statistical Editor
Redaktor statystyczny

Ewa ŁAZUKA
Lublin University of Technology, Lublin, Poland
e.lazuka@pollub.pl

EDITORIAL OFFICE REDAKCJA

Redakcja czasopisma
**Informatyka, Automatyka, Pomiary w
Gospodarce i Ochronie Środowiska**
Katedra Elektroniki i Technik
Informacyjnych
Politechnika Lubelska
ul. Nadbystrzycka 38A, 20-618 Lublin
tel. +48 81 53 84 309,
fax: +48 81 53 84 312
iapgos@pollub.pl
www.e-iapgos.pl
iapgos.pollub.pl
ph.pollub.pl/index.php/iapgos

PUBLISHER WYDAWCA

Politechnika Lubelska
ul. Nadbystrzycka 38D
20-618 Lublin
tel. +48 81 53 84 100
www.pollub.pl
ph.pollub.pl

EDITORIAL BOARD KOMITET REDAKCYJNY

Editor-in-Chief
Redaktor naczelny

Pawel KOMADA
Lublin University of Technology, Lublin, Poland
p.komada@pollub.pl

Topical Editors
Redaktorzy działowi

Electrical Engineering
Elektrotechnika

Jan SIKORA
Research and Development Center Netrix S.A.,
Lublin, Poland sik59@wp.pl

Computer Science
Informatyka

Dominik SANKOWSKI
Lodz University of Technology, Lodz, Poland
dsan@kis.p.lodz.pl

Electronics
Elektronika

Pavel FIALA
Brno University of Technology, Brno, Czech
Republic fialap@feec.vutbr.cz

Automatic
Automatyka

Waldemar WÓJCIK
Lublin University of Technology, Lublin, Poland
waldemar.wojciek@ pollub.pl

Environmental Engineering
Inżynieria środowiska

Lucjan PAWŁOWSKI
Lublin University of Technology, Lublin, Poland
l.pawlowski@pollub.pl

Mechtronics
Mechatronika

Krzysztof KLUSCZYŃSKI
Silesian University of Technology, Gliwice,
Poland krzysztof.kluszcynski@polsl.pl

INTERNATIONAL PROGRAMME COMMITTEE RADA PROGRAMOWO- NAUKOWA

Chairman
Przewodniczący

Waldemar WÓJCIK
Lublin University of Technology, Lublin, Poland

Deputy of Chairman
Zastępca przewodniczącego

Jan SIKORA
Research and Development Center Netrix S.A.,
Lublin, Poland

Members
Członkowie

Kazimierz ADAMIAK

University of Western Ontario, Ontario, Canada

Darya ALONTSEVA

D.Serikbaev East Kazakhstan State Technical
University, Ust-Kamenogorsk, Kazakhstan

Shin-ichi AOQUI

Sojo University, Kumamoto, Japan

Javier BALLESTER

Universidad de Zaragoza, Saragossa, Spain

Yuriii BOBALO

Lviv Polytechnic National University, Lviv,
Ukraine

Oleksy BORYSENKO

Department of Elektronics and Computer
Technics, Sumy, Ukraine

Hartmut BRAUER

Technische Universität Ilmenau, Ilmenau,
Germany

Kathleen CURRAN

School of Medicine & Medical Science, Dublin,
Ireland

Milan DADO

University of Žilina, Žilina, Slovakia

Jarmila DEDKOVA

Brno University of Technology, Brno, Czech
Republic

Andrzej DEMENKO

Poznan University of Technology, Poznań,
Poland

Pavel FIALA

Brno University of Technology, Brno, Czech
Republic

Vladimir FIRAGO

Belarusian State University, Minsk, Belarus

Ryszard GOLEMAN

Lublin University of Technology, Lublin, Poland

Jan GÓRSKI

AGH University of Science and Technology,
Cracow, Poland

Stanisław GRATKOWSKI

West Pomeranian University of Technology
Szczecin, Szczecin, Poland

Antoni GRZANKA

Warsaw University of Technology, Warsaw,
Poland

Jeni HEINO

Helsinki University of Technology, Helsinki,
Finland

Oleksandra HOTRA

Lublin University of Technology, Lublin, Poland

Wojciech JARZYNA

Lublin University of Technology, Lublin, Poland

Mukhtar JUNISBEKOV

M.Kh. Dulaty Taraz State University, Taraz,
Kazakhstan

Piotr KACEJKO

Lublin University of Technology, Lublin, Poland

Krzysztof KLUSCZYŃSKI

Silesian University of Technology, Gliwice,
Poland

Grzegorz KŁOSOWSKI
Lublin University of Technology, Lublin, Poland
Yuriy KRAK
Taras Shevchenko National University of Kyiv,
Kiev, Ukraine
Piotr KSIĄŻEK
Medical University of Lublin, Lublin, Poland
Piotr LESIAK
University of Economics and Innovation in
Lublin Lublin, Poland
Volodymyr LYTVYNENKO
Kherson National Technical University,
Kherson, Ukraine
Artur MEDVIED
Riga Technical University, Riga, Latvia
Pawel MERGO
Maria Curie-Skłodowska University, Lublin,
Poland
Zbigniew OMIOTEK
Lublin University of Technology, Lublin, Poland
Andrzej NAFALSKI
University of South Australia, Adelaide,
Australia
Il Han PARK
Sungkyunkwan University, Suwon, Korea
Lucjan PAWŁOWSKI
Lublin University of Technology, Lublin, Poland
Sergey PAVLOV
Vinnytsia National Technical University,
Vinnytsia, Ukraine

Leonid POLISHCHUK
Vinnytsia National Technical University,
Vinnytsia, Ukraine
Denis PREMEL
CEA Saclay, Gif-sur-Yvette, France
Jason RILEY
The Eunice Kennedy Shriver National Institute
of Child Health and Human Development,
Bethesda, USA
Ryszard ROSKOSZ
Gdańsk University of Technology, Gdańsk,
Poland
Tomasz RYMARCZYK
Research and Development Center Netrix S.A.,
Lublin, Poland
Dominik SANKOWSKI
Lodz University of Technology, Lodz, Poland
Stanislav SLOSARCIK
Technical University of Kosice, Kosice, Slovakia
Jan SROKA
Warsaw University of Technology, Warsaw,
Poland
Bohdan STADNYK
Lviv Polytechnic National University, Lviv,
Ukraine
Henryka Danuta STRYCZEWSKA
Lublin University of Technology, Lublin, Poland
Batyrbek SULEMENOV
Kazakh National Research Technical University
after K.I.Satpayev, Almaty, Kazakhstan
Miroslaw ŚWIERCZ
Bialystok University of Technology, Białystok,
Poland

Stanisław TARASIEWICZ
Université Laval, Quebec, Canada
Murielle TORREGROSSA
University of Strasbourg, Strasbourg, France
Slawomir TUMAŃSKI
Warsaw University of Technology, Warsaw,
Poland
Oleksandr VASILEVSKYI
Vinnytsia National Technical University,
Vinnytsia, Ukraine
Andrzej WAC-WŁODARCZYK
Lublin University of Technology, Lublin, Poland
Zygmunt WARSZA
Industrial Research Institute for Automation and
Measurements, Warsaw, Poland
Sotoshi YAMADA
Kanazawa University, Kanazawa, Japan
Xiaoyi YANG
Beihang University, Beijing, China
Mykola YERMOSHENKO
International Academy of Information Sciences,
Kiev, Ukraine
Athanasiос ZACHAROPOULOS
University College London, London, United
Kingdom
Ivan ZHARSKI
Belarusian National Technical University,
Minsk, Belarus
Cao ZHIHONG
Institute of Soil Science Chinese Academy
of Sciences, Nanjing, China
Pawel ŻUKOWSKI
Lublin University of Technology, Lublin, Poland

PRINTING HOUSE – DRUKARNIA

Soft Vision Mariusz Rajska
<https://www.printone.pl>

nakład: 100 egzemplarzy

OTHER INFORMATION – INNE INFORMACJE

Czasopismo jest indeksowane w bazach:

DOAJ	doaj.org
BazTech	baztech.icm.edu.pl
IC Journals Master List	www.journals.indexcopernicus.com
Google Scholar	scholar.google.pl
POL-index	pbn.nauka.gov.pl
Sherpa RoMEO	www.sherpa.ac.uk
OAJI	oaji.net
SCOPUS	www.scopus.com

Czasopismo *Informatyka, Automatyka, Pomiary w Gospodarce i Ochronie Środowiska* zostało objęte finansowaniem przez Ministerstwo Nauki i Szkolnictwa Wyższego w ramach programu *Wsparcie dla czasopism naukowych* w latach 2019-2020.

Czasopismo znajduje się w wykazie czasopism naukowych opublikowanym w Komunikacie Ministra Edukacji i Nauki z dnia 1 grudnia 2021 r., Unikatowy Identyfikator Czasopisma: 200167 – z przypisaną liczbą punktów przyznawanych za publikację artykułu równą 20.

Zasady publikowania artykułów, przygotowania tekstów, zasady etyczne, procedura recenzowania, wykazy recenzentów oraz pełne teksty artykułów dostępne są na stronie internetowej czasopisma:

www.e-iapgos.pl

W celu zwiększenia oddziaływanego czasopisma w środowisku naukowym redakcja zaleca:

- w artykułach publikowanych w IAPGOS cytować artykuły z renomowanych czasopism międzynarodowych (szczególnie indeksowanych w bazach Web of Science oraz Scopus) używając oficjalnych skrótów nazw czasopism,
- w artykułach publikowanych w innych czasopismach (zwłaszcza indeksowanych w bazach Web of Science oraz Scopus) cytować prace publikowane w IAPGOS – zwłaszcza posługując się numerami DOI, np.:

Kluszczyński K. *Modelowanie – umiejętności czy sztuka?* Informatyka, Automatyka, Pomiary w Gospodarce i Ochronie Środowiska – IAPGOS, 1/2016, 4–15, <https://doi.org/10.5604/20830157.1193833>.

CONTENTS – SPIS TREŚCI

1. Wiktor Kania, Radosław Wajman	
Ckript: a new scripting language for web applications	
Ckript: nowy język skryptowy aplikacji internetowych	4
2. Małgorzata Michalska-Ciekańska	
Multiclass skin lesions classification based on deep neural networks	
Wieloklasowa klasyfikacja zmian skórnych w oparciu o głębokie sieci neuronowe	10
3. Borys I. Mokin, Vitalii B. Mokin, Oleksandr B. Mokin, Orken Mamyrbaev, Saule Smailova	
The synthesis of mathematical models of nonlinear dynamic systems using Volterra integral equation	
Syntez matematycznych modeli nieliniowych układów dynamicznych z wykorzystaniem równania całkowego Volterry	15
4. Martyna Wawrzyc	
The spectrum length method in quantitative interpretation of selected optical spectra	
Metoda długości widma w ilościowej interpretacji wybranych widm optycznych.....	20
5. Natalia Stelmakh, Oleg Belman	
Development of automation of waste sorting as an integral part of environmental protection	
Rozwój automatyzacji sortowania odpadów jako integralna część ochrony środowiska	24
6. Valentyn Zabolotskyi, Yosyp Selepyna, Viktor Lysuk, Natalia Yakymchuk, Anatolii Tkachuk	
Method for evaluation quality parameters of telecommunications services	
Sposób oceny parametrów jakości usług telekomunikacyjnych	30
7. Serhii M. Zakharichenko, Tetiana I. Korobeinikova, Aigul Tungatarova, Bakhyt Yeraliyeva	
New method of on-line successive-approximation ADC calibration	
Nowa metoda kalibracji on-line przetwornika AC metodą kolejnych aproksymacji	34
8. Michał Gołębek, Tomasz Rymarczyk	
Design of innovative measurement systems in ultrasonic tomography	
Konstrukcja innowacyjnych systemów pomiarowych w tomografii ultradźwiękowej	38
9. Alexander V. Osadchuk, Iaroslav A. Osadchuk, Volodymyr V. Martyniuk, Lyudmila V. Krylik, Maria V. Evseeva	
Mathematical simulation of a microelectronic transducer with frequency output for measuring the induction of the magnetic field	
Symulacja matematyczna przetwornika mikroelektronicznego z wyjściem częstotliwościowym do pomiaru indukcji pola magnetycznego.....	43
10. Veronika Cherkashina, Svitlana Litvinchuk, Vladyslav Lesko, Svetlana Kravets, Volodymyr Netrebskiy, Olena Sikorska, Orken Mamyrbayev, Baglan Imanbek	
Study of the electromagnetic impact of the overhead transmission lines of 330 KV on ecological systems	
Badanie oddziaływania elektromagnetycznego napowietrznych linii przesyłowych 330 KV na systemy ekologiczne.....	50
11. Kostyantyn V. Ovchynnykov, Oleksandr M. Vasilevskyi, Volodymyr M. Sebastianov, Yurii A. Polievoda, Aliya Kalizhanova, Bakhyt Yeraliyeva	
Determination of the optimal frequency of the primary measuring transducer of the thickness of dielectric coatings of metal surfaces	
Wyznaczanie optymalnej częstotliwości pierwotnych przetworników pomiarowych do pomiaru grubości powłok dielektrycznych na powierzchniach metalowych.....	56
12. Leonid K. Polishchuk, Oleh V. Khmara, Oleh V. Piontkevych, Oksana O. Adler, Aigul Tungatarova, Ainur Kozbakova	
Dynamics of the conveyor speed stabilization system at variable loads	
Dynamika systemu stabilizacji prędkości przenośnika przy zmiennych obciążeniach	60
13. Tomasz Rymarczyk, Jan Sikora	
On precision acoustic wave calculation in a frequency domain	
O precyzyjnym obliczaniu fal akustycznych w dziedzinie częstotliwości.....	64
14. Ainur Orazayeva, Jamalbek Tussupov, Waldemar Wójcik, Sergii Pavlov, Gulzira Abdikerimova, Liudmyla Savitska	
Methods for detecting and selecting areas on texture biomedical images of breast cancer	
Metody wykrywania i wyróżniania obszarów w teksturowanych obrazach biomedycznych raka piersi	69
15. Monika Styła, Sebastian Styła	
Numerical simulations of a flat phantom in the near-field of symmetric dipole antenna	
Symulacje numeryczne płaskiego fantomu w bliskim polu symetrycznej anteny dipolowej.....	73
16. Mariia A. Voronenko, Ulzhalgas M. Zhunissova, Saule S. Smailova, Luidmila N. Lytvynenko, Natalia B. Savina, Pavlo P. Mulesa, Volodymyr I. Lytvynenko	
Using Bayesian methods in the task of modeling the patients' pharmacoresistance development	
Zastosowanie metod bayesowskich do modelowania rozwoju farmakoporności u pacjentów	77

CONTENTS – SPIS TREŚCI

1. Wiktor Kania, Radosław Wajman	Ckript: a new scripting language for web applications Ckript: nowy język skryptowy aplikacji internetowych	4
		http://doi.org/10.35784/iapgos.2901
2. Magdalena Michalska-Ciekańska	Multiclass skin lesions classification based on deep neural networks Wieloklasowa klasyfikacja znamion skórnych w oparciu o głębokie sieci neuronowe	10
		http://doi.org/10.35784/iapgos.2963
3. Borys I. Mokin, Vitalii B. Mokin, Oleksandr B. Mokin, Orken Mamyrbaev, Saule Smailova	The synthesis of mathematical models of nonlinear dynamic systems using Volterra integral equation Syntez matematycznych modeli nieliniowych układów dynamicznych z wykorzystaniem równania całkowego Volterry	15
		http://doi.org/10.35784/iapgos.2947
4. Martyna Wawrzyc	The spectrum length method in quantitative interpretation of selected optical spectra Metoda długości widma w ilościowej interpretacji wybranych widm optycznych	20
		http://doi.org/10.35784/iapgos.2931
5. Nataliia Stelmakh, Oleg Belman	Development of automation of waste sorting as an integral part of environmental protection Rozwój automatyzacji sortowania odpadów jako integralna część ochrony środowiska	24
		http://doi.org/10.35784/iapgos.2982
6. Valentyn Zabolotskyi, Yosyp Selepyna, Viktor Lyshuk, Natalia Yakymchuk, Anatolii Tkachuk	Method for evaluation quality parameters of telecommunications services Sposób oceny parametrów jakości usług telekomunikacyjnych	30
		http://doi.org/10.35784/iapgos.2918
7. Serhii M. Zakharichenko, Tetiana I. Korobeinikova, Aigul Tungatarova, Bakhyt Yeraliyeva	New method of on-line successive-approximation ADC calibration Nowa metoda kalibracji on-line przetwornika AC metodą kolejnych aproksymacji	34
		http://doi.org/10.35784/iapgos.2950
8. Michał Gołębek, Tomasz Rymarczyk	Design of innovative measurement systems in ultrasonic tomography Konstrukcja innowacyjnych systemów pomiarowych w tomografii ultradźwiękowej	38
		http://doi.org/10.35784/iapgos.2914
9. Alexander V. Osadchuk, Iaroslav A. Osadchuk, Volodymyr V. Martyniuk, Lyudmila V. Krylik, Maria V. Evseeva	Mathematical simulation of a microelectronic transducer with frequency output for measuring the induction of the magnetic field Symulacja matematyczna przetwornika mikroelektronicznego z wyjściem częstotliwościowym do pomiaru indukcji pola magnetycznego	43
		http://doi.org/10.35784/iapgos.2921
10. Veronika Cherkashina, Svitlana Litvinchuk, Vladyslav Lesko, Svetlana Kravets, Volodymyr Netrebskiy, Olena Sikorska, Orken Mamyrbayev, Baglan Imanbek	Study of the electromagnetic impact of the overhead transmission lines of 330 KV on ecological systems Badanie oddziaływania elektromagnetycznego napowietrznych linii przesyłowych 330 KV na systemy ekologiczne	50
		http://doi.org/10.35784/iapgos.2933
11. Kostyantyn V. Ovchynnykov, Oleksandr M. Vasilevskyi, Volodymyr M. Sebastianov, Yurii A. Polievoda, Aliya Kalizhanova, Bakhyt Yeraliyeva	Determination of the optimal frequency of the primary measuring transducer of the thickness of dielectric coatings of metal surfaces Wyznaczanie optymalnej częstotliwości pierwotnych przetworników pomiarowych do pomiaru grubości powłok dielektrycznych na powierzchniach metalowych	56
		http://doi.org/10.35784/iapgos.2948
12. Leonid K. Polishchuk, Oleh V. Khmara, Oleh V. Piontkevych, Oksana O. Adler, Aigul Tungatarova, Ainur Kozbakova	Dynamics of the conveyor speed stabilization system at variable loads Dynamika systemu stabilizacji prędkości przenośnika przy zmiennych obciążeniach	60
		http://doi.org/10.35784/iapgos.2949
13. Tomasz Rymarczyk, Jan Sikora	On precision acoustic wave calculation in a frequency domain O precyzyjnym obliczaniu fal akustycznych w dziedzinie częstotliwości	64
		http://doi.org/10.35784/iapgos.2966
14. Ainur Orazayeva, Jamalbek Tussupov, Waldemar Wójcik, Sergii Pavlov, Gulzira Abdikerimova, Liudmyla Savitska	Methods for detecting and selecting areas on texture biomedical images of breast cancer Metody wykrywania i wyróżniania obszarów w teksturowanych obrazach biomedycznych raka piersi	69
		http://doi.org/10.35784/iapgos.2951
15. Monika Styła, Sebastian Styła	Numerical simulations of a flat phantom in the near-field of symmetric dipole antenna Symulacje numeryczne płaskiego fantomu w bliskim polu symetrycznej anteny dipolowej	73
		http://doi.org/10.35784/iapgos.2974
16. Mariia A. Voronenko, Ulzhalgas M. Zhunissova, Saule S. Smailova, Luidmila N. Lytvynenko, Natalia B. Savina, Pavlo P. Mulesa, Volodymyr I. Lytvynenko	Using Bayesian methods in the task of modeling the patients' pharmacoresistance development Zastosowanie metod bayesowskich do modelowania rozwoju farmakoporności u pacjentów	77
		http://doi.org/10.35784/iapgos.2968

STUDY OF THE ELECTROMAGNETIC IMPACT OF THE OVERHEAD TRANSMISSION LINES OF 330 KV ON ECOLOGICAL SYSTEMS

Veronika Cherkashina¹, Svitlana Litvinchuk², Vladyslav Lesko³, Svetlana Kravets⁴, Volodymyr Netrebskiy³, Olena Sikorska³, Orken Mamyrbayev⁵, Baglan Imanbek⁵

¹Kharkiv National Technical University "Kharkiv Polytechnic Institute", Kharkiv, Ukraine, ²Mykolayiv National Agrarian University, Mykolayiv, Ukraine

³Vinnytsia National Technical University, Vinnytsia, Ukraine, ⁴Vinnytsia National Agrarian University, Vinnytsia, Ukraine, ⁵Al Farabi Kazakh National University, Institute of Information and Computer Technologies, Almaty, Kazakhstan

Abstract. The analysis of factors and approaches to the conditioning of the electromagnetic impact of 330 kV overhead transmission lines on ecological systems has been carried out. The analysis performed enabled to reveal that the world experience, recording the introduction of the transmission lines of the carrying capacity and reduced environmental impact, including the compact and controlled self-compensating lines, is expedient to take into consideration in the process of the object design, as compared with the transmission line of the conventional construction, operated in Ukraine. The technique of electromagnetic field of the 330 kV overhead transmission lines calculation is improved for the ecological systems and to clarify the width of the sanitary protection zone. Unlike other technique, the given one takes into account the line clearance and the sag of, also this technique is universal as it enables to calculate and analyze the variation of the electromagnetic field of the overhead transmission lines of different construction not only on the line route, but also at a distance from it.

Keywords: overhead transmission line, construction, electromagnetic field, ecologic system, sanitary protection zone

BADANIE ODDZIAŁYWANIA ELEKTROMAGNETYCZNEGO NAPOWIETRZNYCH LINII PRZESYŁOWYCH 330 KV NA SYSTEMY EKOLOGICZNE

Streszczenie. Przeprowadzono analizę czynników i podejść do uwarunkowań oddziaływanego elektromagnetycznego napowietrznych linii przesyłowych 330 kV na systemy ekologiczne. Analiza pozwoliła stwierdzić, że doświadczenia światowe, odnotowujące wprowadzenie linii przesyłowych o większej nośności i mniejszym oddziaływaniu na środowisko, w tym liniach kompaktowych i sterowanych samokompensujących, są celowe do uwzględnienia w procesie projektowania obiektu, w porównaniu z linią przesyłową o konstrukcji konwencjonalnej, eksploatowaną na Ukrainie. Technika obliczania pola elektromagnetycznego napowietrznych linii przesyłowych 330 kV została udoskonalona pod kątem systemów ekologicznych oraz w celu uszcislenia szerokości strefy ochrony sanitarnej. W odróżnieniu od innych technik, ta uwzględnia prześwit i zwis linii, a także jest uniwersalna, gdyż umożliwia obliczanie i analizę zmienności pola elektromagnetycznego napowietrznych linii przesyłowych o różnej konstrukcji nie tylko na trasie linii, ale także w pewnej odległości od niej.

Słowa kluczowe: napowietrzna linia przesyłowa, budowa, pole elektromagnetyczne, system ekologiczny, strefa ochrony sanitarnej

Introduction

Rates of commissioning of objects of electric power systems of Ukraine reached their peak values in the 60-70s of the last century. Nowadays with the same rate electric engineering objects overstep their 50-year limit. In the process of operation, the conditions of electric power systems changed, these changes are characterized by an increase of the transmitted power density both in normal modes and in emergency modes, necessity of the compact realization of the electric energy objects due to considerable rise in the value land, increased requirements concerning the reliability, controllability and automation, as well as a more rigid ecological policy.

Increase of the compactness and ecological safety of the electric energy objects in the requirement of the present day, the necessity to apply new approaches for the assessment of the priority decisions.

Right of ways under overhead transmission lines with the account of their considerable length can reach considerable size. For electrical – of 35 – 750 kV the area of the disposed territories as a result of the overhead transmission lines passage is 21,179.55 km [5].

This problem is extremely actual for the territories with the developing infrastructure, where the value of land increases exponentially. To reduce the disposal of territory under the overhead transmission lines and decrease the ecological impact so-called non-conventional line find wide application along with the overhead transmission lines of the conventional construction: compact overhead lines (COL); controllable self-compensated overhead lines (CSCOL); overhead lines with circuits of different voltage classes (combined overhead lines); overhead lines with insulated conductors (OLIC) [1].

1. Aim of the paper

Analyze factors and approaches, regulating electromagnetic impact of the overhead lines on the ecological systems. Improve the technique of the electromagnetic field strength – fir the determination of their impact on ecological systems and to – the width of the sanitary-protection zone, depending on the construction of the lines.

2. Main materials of the research

Analysis of factors and approaches to the normalization of the electromagnetic impact of the overhead transmission lines on the ecological systems. Relatively the impact of the AC overhead transmission lines on the ecological systems, the criteria of the harmful impact assessment are established, principles of regulation and protection measures. Numerous international organizations, such as the World Health Organization (WHO), the International Electrotechnical Commission (IEC), the European Committee for Electrotechnical Standardization (CENELEC), the Commission of the European Union (CEU), National Commissions, deal with problems of the normalization of electromagnetic field influencing the staff and population.

Main factor of the overhead transmission lines of 330 kV, determining the width of the sanitary-protection zone and influencing the ecological systems in electromagnetic field (EMF), characterized by the electromagnetic field strength. All the manifestations of the negative impact on the ecological systems may be divided into groups [1, 7, 10, 14]:

1. Impact of the electromagnetic field on the living organisms.
2. Impact of the harmonic noise on communication lines.
3. Interaction of overhead lines with engineering communications.
4. Acoustic impact of overhead lines on the environment.
5. Interaction of overhead lines with the natural landscape.



Normalization of the factors of AC overhead lines impact, their coordination with the results of numerous and sometimes contradictory medical research is extremely complex task, especially taking into simultaneous and interconnected impact of several factors. The importance of the consideration of EMF impact on the ecological systems all over the world is caused by the necessity of the objective assessment of the real danger for human health. Such an approach is determined also by the economic reasons as the observance of the sanitary norms and provision of the normalized width of the sanitary-protection zone for overhead lines (OHL) is connected with the considerable expenditures.

By its frequency characteristic electromagnetic field (EMF) of the overhead lines (OHL) is referred to the low-frequency range. As a rule, the staff maintaining the overhead installations is exposed by the short-term impact of the strong EMF. The population mainly remains in the zone of the weak fields of the industrial frequency, for instance, living near an overhead lines.

Nowadays the attention of the biophysicists and medical scientists is drawn not only to the study of the effects of short-term impact of the strong fields, but to the determination of the long-term consequences impact of weak low-frequency EMF, up to the super weak ones with the intensity of approximately 0.1 A/m (0.12 μ T), comparable with the intensity of low-frequency earth geomagnetic field.

It is known that the intensity of EMF near 330 kV overhead lines and higher may reach the boundary of the individual field susceptibility, when a person by indirect indication (hair stirring, pin sensation between the body and clothing) can determine the field. Approximately 5% of people feel the presence of EMF, starting from the intensity of 7 kV/m, and 60% do not feel the field with the intensity of up to 20 kV/m. Intensity of the EMF of 5 kV/m, acceptable by the standard, determined by biological impact be acceptable, taking into account the possible unfavorable. Action of the electrical charges in the process of the human contact with surrounding objects. By the results of the research the intensity of the EMF, when 80% of people do not feel pain sensations at the discharges, equals 5.2 kV/m [6, 8, 10, 11].

Negative impact of EMF of the industrial frequency was disclosed as a result of the examination of the staff, servicing energy objects, experiments on the laboratory animals and study volunteers, carried out since the 60s of the last century, further in the studies of numerous researchers. International recognition of the biological activity of EMF required the residence time regulation. As a result, in the USSR state standard GOST 12.1.002-84 was elaborated and approved. For the staff of the unrelated organizations and the local population the following norms were established: 20 kV/m for the in accessions location; 15 kV/m for unpopulated areas. Besides, admissible intensity 0.5 kV/m is normalized this allows the stay of a person in the electrical field for 24 hours a day.

International recommendations are based on the revealing of the negative impact on the organism, manifested directly at the moment or immediately after impact to EMF, and do not take into account possible long-term exposure to the impact of weak EMF [4, 7, 12, 13, 15].

As a result of numerous researches, carried out in recent decades the biological activity of weak low-frequency fields was revealed. This result turned out to be unexpected, because as a rule, the intensity of the bioeffects increases in proportionally the intensity of the acting factor. Swedish, Finnish, American, Canadian, French researchers identified carcinogenic effect up weak EMF.

Simultaneously, there appeared studies, denying these observations. Nowadays, approximately 30% of the studies prove that weak EMF of the industrial frequency can increase

the number of a cancer related disease, 30% of studies claim the opposite and in 40% of cases scientists neither agree nor disagree, considering that epidemiological studies must be well-planned taking into account the variety of the factors of the environment and professional activity [4, 7, 15].

In 1996, World Health Organization (WHO) initiated the International EMF Project. The aim of the given project is to collection, analysis, generalization and coordination of the results of all the investigations, carried out in this field. In 2001 WHO issued information message, recommending to keep to the "precautionary principle" regarding the impact of low-intensity EMF and by all available means limiting the impact of EMF on human. In 1998, the International Committee ICNIRP, one of the participants in the WHO Project, released the document, regulating the permissible levels of EMF for the population.

All developed countries realize their programs to studying the impact of electromagnetic radiation on human and environment. For instance, Austria, Germany, Czech Republic, Australia, Spain, Italy and other countries, follow the recommendations suggested by ICNIRP, recording the regulation of EMF [4, 7, 12–15].

In general case, the parameter which determines the degree of EMF impact on a human is the density of the current induced in the body. In greater part of the International Standards non-dangerous for the organism density of current 10 mA/m² is considered as the initial value for establishing of the admissible levels of EMF parameters. Equivalent intensity of EMF, corresponding to this density, can then be decreased, applying the factor of margin for the conditions of the industrial impact and for the population. Reference level, obtained in such a way is fixed as normalized levels [7].

Such an approach to the normalization of the factors is often used abroad. In Ukraine and in some other countries, as the parameter, determining admissible levels of field intensity, maximum admissible current, flowing across the human body in case of the contact in the zone of EMF impact with the isolated machine or other large insulated object is considered. Environmental legislation functioning in Ukraine, defines principles, rules and ecological system. So-called sanitary regulation, regulating maximum permissible levels of the electric field intensity, formed by A.C. electric transmission installation of the industrial frequency [14].

Staying of the people, not electrical engineering staff, in the zone of EMF impact nowadays in Ukraine is regulated by the intensity of EMF, which is on the territory of the residential area –1 kV/m. But it should be noted that such level of EMF intensity is on the boundary of sanitary-protection zone of the overhead lines, limits of which on the both sides from the projection of the outer conductors on the earth are: 20 m – for 330 kV overhead lines and 40 m – for 750 kV overhead lines and for the overhead lines below 330 kV sanitary-protection zones are not established [10, 14].

As the organization of the boundaries of sanitary protection zone of the overhead lines is connected not only with considerable economic expenses, but also with the exclusion of land. This circumstance caused the necessity to perform the additional calculations of EMF impact factor in the points, remote from the conductors of the line and indicate the boundaries of the sanitary-protection zone. As in Ukraine conventional overhead lines are used, then all normative documents correspond to certain construction realization. Taking into consideration the world experience, regarding the introduction of the transmission lines of enhanced carrying capacity and decreased ecological impact, to which compact and controlled self-compensating overhead lines, are referred to, it is expedient to consider them and compare with the conventional overhead lines.

3. Method

Formation of the technique of EMF intensity calculation for the determination of 330 kV overhead lines impact on the ecological systems and adjustment of the width of sanitary-protection zone, depending on the construction of the lines.

From the point of view of determination of EMF impact on the ecological systems, that is determined by the value of EMF intensity, the problem is reduced to finding the potential of the conducting body placed in the field of the overhead line (Fig. 1).

For the determination the EMF intensity of 330 kV overhead lines of various construction (Fig. 1), the following initial data are used: U – the voltage of the overhead lines (OHL), kV; H – dimensions of the conductors of overhead lines, m; H_w – dimensions of the steel wires of the overhead lines, m; S_w – distance from the axis of the overhead line to the steel wire, m; S_z – distance between phase circuits, m; S_f – distance between phases, m; a – the distance between the conductors in a phase, m; n – the number of conductors in a phase; r_{cond} – radius of the overhead line wire, m; r_w – radius of the steel wire, m; L – horizontal distance from the axis of the outer conductor of the overhead line to the calculated point, m (towards the middle phase with the sing “-”); h – coordinates of the preset point, m; Δh – differentiation step, m.

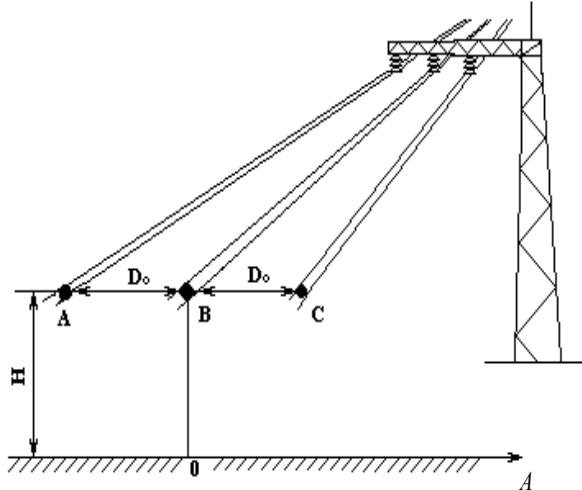


Fig. 1. Schematic representation of the overhead line for the determination of EMF intensity

Calculation of the field parameters is possible to perform using Maxwell equation for the system "conductors – steel wires – earth" [2, 3, 9]:

$$U_{ij} = \sum_{n=1}^n \alpha_{ij} \cdot q_{ij} \quad (1)$$

where U – phase voltage of the overhead line conductors; α_{ij} – are potential coefficients; q_{ij} – are charges of conductors per unit length.

Potential coefficients α_{ij} are determined from the following relations:

Proper potential coefficients $i = j$

$$\alpha_{ii} = \frac{1}{2\pi\varepsilon} \ln \frac{H_{ii}}{r_{ii}} \quad (2)$$

where H_{ii} – is the distance between the i^{th} conductor and its mirror reflection; r_{ii} – is equivalent radius of the conductor or steel wire.

Mutual potential coefficients $i \neq j$

$$\alpha_{ij} = \frac{1}{2\pi\varepsilon} \ln \frac{H_{ij}}{r_{ij}} \quad (3)$$

where H_{ij} – is the distance between i^{th} conductor and mirror reflection of the j^{th} conductor; r_{ij} – is the distance between i^{th} and j^{th} conductors.

Using the system of equations (1) the potential coefficients of the impact object α_{jA} are identified

$$\alpha_{jA} = \frac{1}{2\pi\varepsilon} \ln \frac{H_{jA}}{r_{ji}} + L \quad (4)$$

where H_{jA} – is the distance between the j^{th} conductor and object; r_{ji} – is the distance between i^{th} and j^{th} conductors; L – is the distance to the object.

Using the second group of Maxwell equations for the determination of the charges on the conductor's capacitive coefficients β are formed:

$$q_{ij} = \sum_{n=1}^n \beta_{ij} \cdot U_{ij} \quad (5)$$

However, it should be noted that the given technique does not require the calculation of the charge on the conductors and the system of equations (4) is used only for the formation of the capacitance coefficients β , which are determined by the formula:

$$\beta_{ij} = (-1)^{i+j} \Delta_{ij} / \Delta \quad (6)$$

where Δ – is the matrix determinant, composed of the coefficients α of the Maxwell equations system (1); Δ_{ij} – is the algebraic complement of the i^{th} and j^{th} elements.

In the process of improvement of the given model the symmetry of the three-phase system of voltages $\dot{U}_1, \dot{U}_2, \dot{U}_3$ was taken into account:

$$\begin{aligned} \dot{U}_1 &= U \\ \dot{U}_2 &= U \cdot a \\ \dot{U}_3 &= U \cdot a^2 \end{aligned} \quad (7)$$

where a and a^2 are complex operators of voltage vector rotation, $a = -0.5 + j0.86$; $a^2 = -0.5 - j0.86$

Potential \dot{U}_A in the present point is determined using (1 – 7):

$$\begin{aligned} \dot{U}_A &= U \sum [\beta_{ij} - 0.5(\beta_{ij} + \beta_{ij})\alpha_{jA}] + \\ &+ U \sum j0.86[(\beta_{ij} - \beta_{ij})\alpha_{jA}] \end{aligned} \quad (8)$$

Having denoted the active and reactive parts of \dot{U}_A by \dot{U}_{Aa} and \dot{U}_{Ap} correspondingly for the module \dot{U}_A we will write down the equation:

$$U_A = \sqrt{\dot{U}_{Aa}^2 + \dot{U}_{Ap}^2} \quad (9)$$

While determining the field strength at point A, we will change its vertical component. Having determined the potential at point U_A in point A at height h and \dot{U}_A' in the point A' at the $h - \Delta h$ the field strength is determined by expression:

$$E_A = \frac{U_A - U_A'}{\Delta h} \quad (10)$$

The obtained value E_A corresponds to the vertical component of the average strength of the electric field in the region of the human head of a person of 1.8 m of height.

4. Results and discussion

Improved technique of calculation unlike other techniques, takes into account the dimension of the line and the sag of the conductor as well it is universal because it enables to calculate and analyze the change of EMF of 330 kV overhead lines of different constructions.

Application of modern technical facilities enables to solve the given task with extreme accuracy. The developed technique was used to compose the block-diagram for automatic calculation of the zone of electromagnetic impact of 330 kV overhead lines on the ecological systems (Fig. 2).

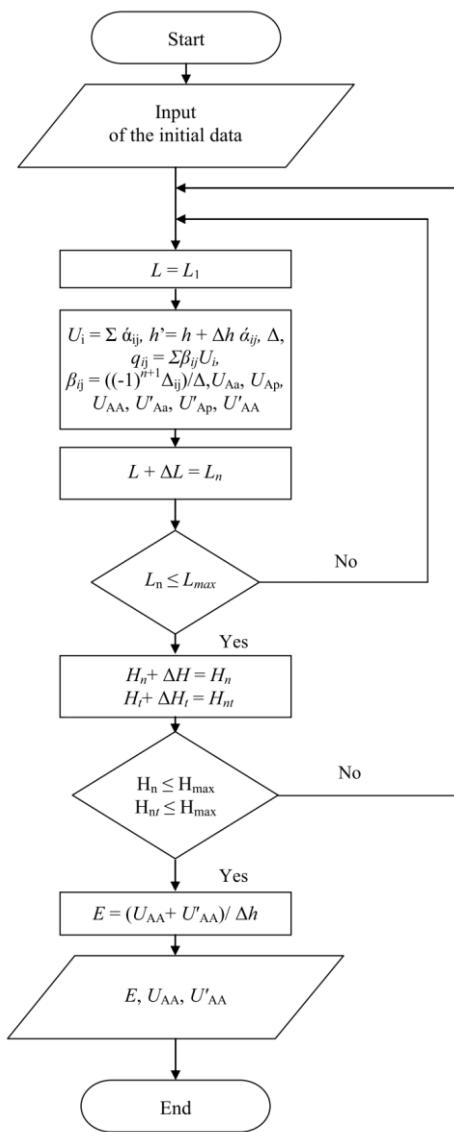


Fig. 2. Block-diagram for automated calculation of the zone of electromagnetic impact of the overhead transmission lines on the ecological systems

Modification of the EMF strength of the overhead lines of 330 kV depends on the dimension and construction of the lines, this is proved by the results of the calculations, performed according to the improved technique [1–10], using block-diagram (Fig. 2) by means of the programming platform the PowerCalc (Copyright Inprise Corporation) and presented in tables 1–3, and figure 3–5.

Fig. 6 presents the generalized graphical representation of the span of the 330 kV overhead transmission line.

Proceeding from the above-mentioned, it follows that the improvement of the construction of 330 kV overhead transmission lines not only increases their carrying capacity, but also limits the strength of EMF near the overhead transmission line, that leads to the decrease of the eliminated areas for overhead transmission lines. Thus, in the process of overhead transmission lines design, routes of which pass near the residential areas or other places where people remain for a long time (play grounds, gardens) it is expedient to include in the pre-project assessment of the variants the analysis of electromagnetic situation near the route of the overhead transmission line, in particular, consider the strength value of EMF not only on the route of the line, but also at a distance of more than 20 m from the projection of the outer conductor, because with the distance from the overhead transmission line, the strength decreases slower, than at small distances, that is why, the given fact requires more accurate calculation [16, 17].

Table 1. Modification of the EMF strength for 330 kV overhead transmission lines of the conventional construction

Dimension H, m	Distance, m	E, kV/m	Distance, m	E, kV/m	Distance, m	E, kV/m
10	20	0.997	20	0.997	28	0.466
12	20	1.21	23	0.922	32	0.445
14	20	1.41	25	0.936	34	0.486
16	20	1.58	27	0.941	36	0.493
20	20	1.78	30	0.976	44	0.462
24	20	1.84	33	0.962	48	0.485
26	20	1.83	34	0.965	50	0.489

Table 2. Modification of the EMF strength compact for 330 kV overhead transmission lines

Dimension H, m	Distance, m	E, kV/m	Distance, m	E, kV/m	Distance, m	E, kV/m
10	20	1.13	22	0.938	30	0.468
12	20	1.34	22	0.938	33	0.467
14	20	1.51	26	0.926	35	0.491
16	20	1.65	27	0.982	38	0.482
20	20	1.81	30	0.983	43	0.483
24	20	1.83	32	0.996	47	0.472
26	20	1.81	33	0.988	49	0.491

Table 3. Modification of EMF strength value for the controlled self-compensating 330 kV overhead transmission lines

Dimension H, m	Distance, m	E, kV/m	Distance, m	E, kV/m	Distance, m	E, kV/m
10	20	0.549	16	0.846	22	0.450
12	20	0.644	16	0.957	24	0.494
14	20	0.725	18	0.864	26	0.445
16	20	0.892	18	0.927	28	0.439
20	20	0.868	18	0.984	30	0.471
26	20	0.870	18	0.952	32	0.496

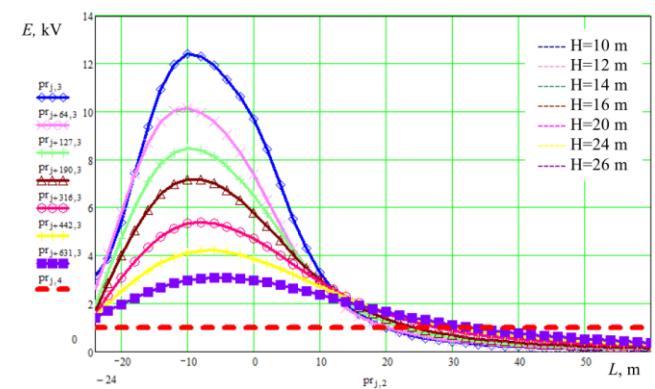


Fig. 3. Dependence of EMF strength modification on the dimension of 330 kV overhead transmission line of the conventional construction

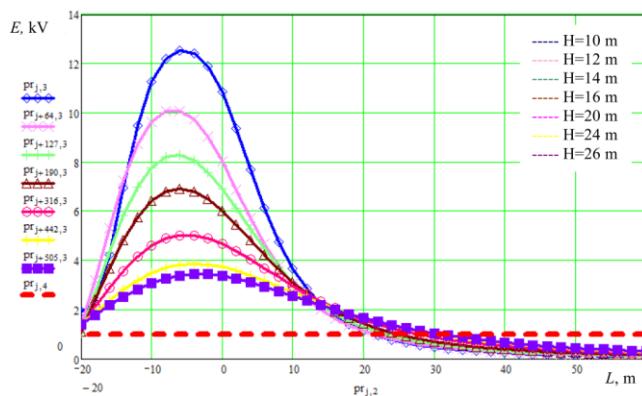


Fig. 4. Dependence of EMF strength modification of the dimension of compact 330 kV overhead transmission line

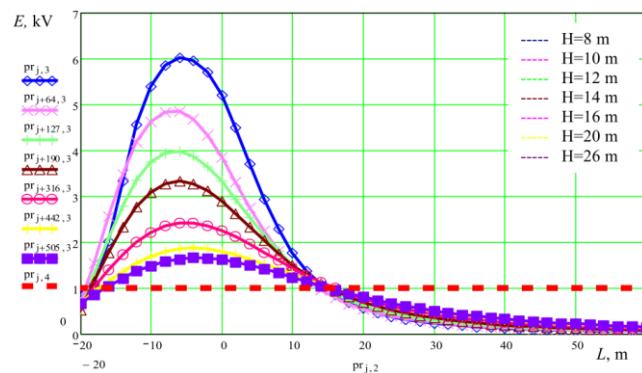


Fig. 5. Dependence of EMF strength modification on the dimension of CSOTL 330 kV

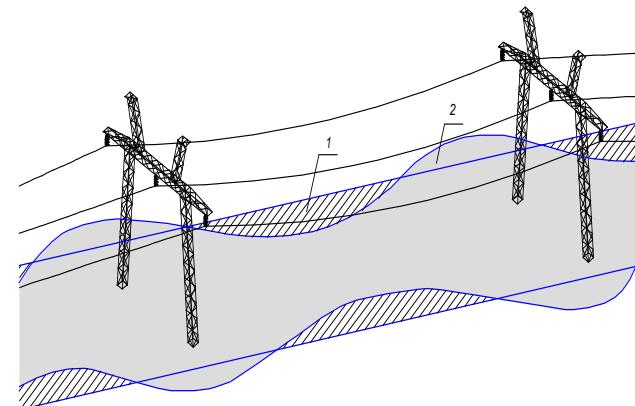


Fig. 6. Generalized graphical presentation of the span of 330 kV overhead transmission line: 1 – territory, normalized for the overhead transmission line, with the account of sanitary-protection zone; 2 – the territory, calculated for the overhead transmission line, with the account of sanitary protection-zone

For the realization of these tasks the following engineering solutions can be used:

- decrease of the interphase distances at a result of carrying out measures, aimed at reduction of the calculated overvoltage ratio;
- transition from the conventional to compact and self-compensating transmission lines of the increased carrying capacity and reduced ecological impact;
- usage of the vegetation arrays to provide the ecological safety of the lines.

5. Conclusions

1. Analysis of the factors and approaches of the normalization of the electromagnetic impact of the overhead transmission lines of 330 kV on ecological systems enables to determine that the world experience regarding the implementation of the overhead transmission lines of the increased carrying capacity and decreased ecological impact, which compact and controlled self-compensating overhead lines are referred, it is expedient to take into account in the process of the object design as compared with the lines of the conventional construction, operated in Ukraine.

2. Technique of the 330 kV the electromagnetic field strength for the determination of their impact on the ecological systems and specification of the sanitary-protection zone width is improved. Unlike other techniques, the given technique takes into account the dimension of the line and sag of the conductor, it is universal because it enables to calculate and analyze of the electromagnetic field of the 330 kV overhead transmission lines of different constructions. Realization of the given technique in the package of programs APM of the designer of the overhead transmission lines will enable determine with greater efficient the main direction in the process of the object design, taking into account electromagnetic situation not only on the route of the line, but also at the distance from it.

References

- [1] Cherkashina V. V., Cheremisin M. M.: Establishment of a priority projecting line in the minds of the day. Proceedings of Controlled power transmission lines 2007–2017, 9, 2017, 50–91.
- [2] Cherkashina V. V., Cheremisin M. M.: In accordance with the method of assessing the tension of electric fields of power transmission lines. Proc. 5th Inter. Sc. and Pract. Conf. Problems and prospects for the development of energy, electrical technology and automation in the agro-industrial complex, 2019, 31–32.
- [3] D'yakov A. F. (ed.): Super- and Ultrahigh Voltage Electrical Networks of the Russian Unified Energy System. Theoretical and Practical Base. STC Energopress, Moscow 2012.
- [4] Directive 2013/35/EU. Electromagnetic fields: Social innovation “EaSI” (2014–2020).
- [5] Energy strategy of Ukraine for the period up to 2035 r. “Safety, energy efficiency, competitiveness”. Ordering from September 18, 2017. No. 605-r. <http://www.ukrenergo.energy.gov.ua>
- [6] Hatibovic A.: Advanced Application of the Catenary and the Parabola for Mathematical Modeling of the Conductor and Sag Curves in the Span of an Overhead Line (doctoral thesis). Óbuda University, Budapest 2019.
- [7] International Commission on Non-Ionizing Radiation Protection (ICNIRP): Guidelines for limiting exposure to electromagnetic fields (100 kHz to 300 GHz). Health Physics 118(5), 2020, 483–524.
- [8] Ivanov I. E.: Assessment of the influence of various factors on the values of resistances and conductivities of a high-voltage overhead power line. Bulletin of ISUE 3, 2017, 30–39.
- [9] Morozov Yu. A., Yakobson B. G.: A simplified method for calculating the electric field strength under the wires of high-voltage power lines. Sci. slave. Institute of Labor Protection All-Union Central Council of Trade Unions 103, 1976, 21–23.
- [10] Rules for the regulation of electrical installations. Industry, Kharkiv 2017.
- [11] Singhal A: Volt/var control with high solar PV penetration in distribution systems and its impact on the transmission grid (Theses and Dissertations). Iowa State University, Ames 2019.
- [12] Stam R.: Comparison of international policies on electromagnetic fields. National Institute for Public Health and the Environment, Bilthoven 2018.
- [13] Stam R.: National precautionary policies on magnetic fields from power lines in Belgium, France, Germany, the Netherlands and the United Kingdom. National Institute for Public Health and the Environment, Bilthoven 2018.
- [14] State sanitary norms and rules of protection of the population from the effects of electromagnetic radiation with changes were registered by the Ministry of Justice of Ukraine on May 16, 625/30493, 2017.
- [15] Statement and further consultation: Proposed measures to require compliance with international guidelines for limiting exposure to electromagnetic fields (EMF). Ofcom, 2020.
- [16] Vasilevskyi O. M., Kulakov P. I., Dudatieve I. A. et al.: Vibration diagnostic system for evaluation of state interconnected electrical motors mechanical parameters. Proc. of SPIE 10445, 2017, 104456C.
- [17] Vasilevskyi O., Didych V., Kravchenko A. et al.: Method of evaluating the level of confidence based on metrological risks for determining the coverage factor in the concept of uncertainty. Proc. of SPIE 10808, 2018, 108082C.

D.Sc. Eng. Veronika Cherkashina
e-mail: veronika2473@gmail.com

Doctor of Science (Engineering), associate professor, Department of Electric Power Transmission, Kharkiv National Technical University "Kharkiv Polytechnic Institute", Kyrpychova str., 2, 61002, Kharkiv, Ukraine.



<http://orcid.org/0000-0002-5639-9722>

Ph.D. Volodymyr Netrebskiy
e-mail: netrebskiy@ukr.net

Ph.D., associate professor, Department of Power Plants and Systems, Vinnytsia National Technical University, Khmelnytsky highway, 95, 21000, Vinnytsia, Ukraine



<http://orcid.org/0000-0003-2855-1253>

Ph.D. Svitlana Litvinchuk
e-mail: svitlanalitvinchk@ukr.net

Ph.D. in pedagogy, associate professor of the Department of Methodology of Vocational Training, Faculty of Engineering and Energy, Mykolaiv National Agrarian University. Author of more than 50 publications, including five textbooks and more than 30 scientific articles in professional journals, 7 of them in scientometric databases Web of Science, Google Scholar, Index Copernicus International.



<http://orcid.org/0000-0002-9885-7234>

Ph.D. Olena Sikorska
e-mail: olenasikorska@ukr.net

Ph.D., Department of Power Plants and Systems, Vinnytsia National Technical University, Khmelnytsky highway, 95, 21000, Vinnytsia, Ukraine



<http://orcid.org/0000-0001-7341-9724>

Ph.D. Vladyslav Lesko
e-mail: leskovlad@ukr.net

Ph.D., associate professor, Department of Power Plants and Systems, Vinnytsia National Technical University, Khmelnytsky highway, 95, 21000, Vinnytsia, Ukraine.



<http://orcid.org/0000-0002-5477-7080>

Ph.D. Orken Mamyrbayev
e-mail: morkenj@mail.ru

Deputy General Director in science and head of the Laboratory of computer engineering of intelligent systems at the Institute of Information and Computational Technologies of the Kazakh National Technical University named after K. I. Satbayev and associate professor in 2019 at the Institute of Information and Computational Technologies. Main research field: machine learning, deep learning, and speech technologies.
<http://orcid.org/0000-0001-8318-3794>



M.Sc. Svetlana Kravets
e-mail: swkravec2017@gmail.com

M.Sc., research assistant, Department of Technological Processes and Equipment for Processing and Food Industries, Vinnytsia National Agrarian University.



<http://orcid.org/0000-0001-8628-8479>

Ph.D. Baglan Imanbek
e-mail: imanbek.baglan18.06@gmail.com

Ph.D., associate professor, Department of AI&BigData, Al Farabi Kazakh National University, Almaty, Kazakhstan.



<http://orcid.org/0000-0001-7249-380X>